

Statistical Analysis of Feeder and Locational PV Hosting Capacity for 216 Feeders

Matthew J. Reno and Robert J. Broderick

Electric Power Systems Research
Sandia National Laboratories
Albuquerque, NM, USA

Abstract — As PV penetration on the distribution system increases, there is growing concern about how much PV each feeder can handle. A total of 216 medium-voltage distribution feeders have been analyzed in detail for their individual PV hosting capacity and the locational PV hosting capacity at all the buses on the feeder. A statistical analysis is performed on the hosting capacity results in order to compare correlation with feeder load, percent of issues caused, and the variation for different feeder voltages. Due to the large number of distribution systems simulated, the analysis provides novel insights into each of these areas. Investigating the locational PV hosting capacity also expands the conventional analytical methods that study only the worst-case PV scenario.

Index Terms -- distributed power generation, photovoltaic systems, power distribution, power system interconnection

I. INTRODUCTION

Large PV installations on the distribution system can have many potential impacts to local customer power quality and reliability, such as high or low voltages, system losses, harmonics, increased wear to regulation equipment, voltage flicker, and system protection. The concept of hosting capacity (HC) [1] is used to study how much PV can be placed on a feeder before negative issues are caused to normal distribution system operation and power quality [2-5]. Often PV hosting capacity analysis is performed for a limited number of distribution feeders. For medium-voltage distribution feeders, previous results generally analyze less than 20 feeders [2, 6], and then the results are extrapolated out to similar types of feeders. In this paper, the analysis has been expanded to 216 feeders in order to get a more detailed view of the range and distribution of feeder hosting capacity values. This paper also investigates locational hosting capacity (LHC) [7, 8] to determine the largest PV size that can be interconnected at different locations (buses) on the study feeders. Detailed LHC analysis shows the maximum amount of PV that can be placed throughout the feeder, and under what conditions various types of violations occur.

An overview of the distribution systems analyzed is given in Section II, and the methodology to analyzed these systems is discussed in Section III. The results and analysis of correlation and dependence of hosting capacity on different factors are presented in Section IV. Finally, the paper is concluded in Section V.

II. DISTRIBUTION SYSTEMS ANALYZED

A large database of 216 feeders from various utilities throughout the United States [9-14] was simulated using the detailed methodology described in Section III. The feeders range in length from 1.8 km to 52.5 km. The number of buses in each feeder also varies significantly from 142 buses to 6001 buses per feeder. The peak load for each of the feeders ranges from 0.6 MW to 28.5 MW. The number of feeders at each voltage classes is shown in Table I. There is also a range in the incoming high-voltage transmission system at the substation for each feeder from 46 kV to 230 kV.

TABLE I. FEEDER VOLTAGE CLASSES

Voltage Level	4 kV	12 kV	12.47 kV	13.2 kV	13.8 kV	16 kV	19.8 kV	20.78 kV	22.9 kV	24.9 kV	33 kV	34.5 kV
Feeders	18	43	96	3	8	2	16	6	3	9	1	11

For the majority of feeders, the utility also provided at least a year of substation SCADA measurements for the feeder and the full details about substation impedance, voltage regulator settings, and capacitor switching controls. The load allocation method used for each feeder varies depending on the data provided, such as billing kWh data, metered peak demand, etc. Each feeder also includes an approximate model of the secondary system, often using standard transformer impedances by kVA size and 100 feet of 1/0 triplex cable between the transformer and the customer. Due to the number of feeders, some infrequent features are captured, such as 3-wire feeders without neutral wires and feeders with multiple voltage levels due to step-down transformers.

Most of the feeders (173 of 216) have no voltage line regulators inside the feeder itself, but as seen in Fig. 1, there can be up to 6 regulators per feeder. There are several different types of voltage regulators, including wye-connected phase regulators, gang-operated delta-connected regulators, and open-delta regulators. Both the fixed and switching capacitors are modeled for each feeder. As seen in Fig. 2, the feeders have between 0 to 13 capacitors per feeder. Most of the switching capacitors are voltage-controlled, but there are also time-controlled, temperature-controlled, kVAR-controlled, time-biased voltage-controlled, and seasonally-controlled capacitors.

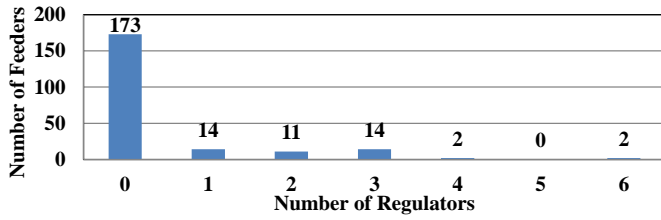


Fig. 1. Histogram of the number of voltage regulators on each feeder.

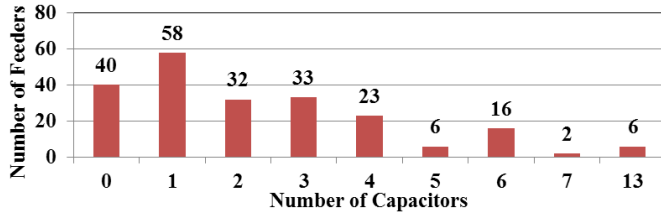


Fig. 2. Histogram of the number of capacitors on each feeder.

III. FEEDER HOSTING CAPACITY ANALYSIS

Each of the study feeders is analyzed using a detailed locational hosting capacity analysis. The methodology in [7, 15] is used to investigate a large number of potential PV scenarios (combinations of PV size and location) in OpenDSS [16]. On average, there are around 40,000 PV scenarios analyzed per feeder. For each PV scenario, a series of simulations is performed to determine if that particular scenario would cause issues on the distribution system. The simulations include a range of load values that occur during daytime hours throughout the year, a range of feeder states as far as regulation equipment taps and switching capacitor states, and simulation of extreme PV output ramps. Steady-state voltage violations are determined using ANSI C84.1, thermal violations are defined by the component's amp rating, and temporary voltage violations are determined using the ITIC (CBEMA) curve. For more details on the analysis methodology and comparison with other HC algorithms see [7, 15]. While the results presented in this paper use one specific HC method, the focus is to provide results for a large number of distribution systems to investigate how hosting capacity correlates with feeder characteristics.

Using the detailed simulation results, the PV size is increased at locations around the feeder until an issue or violation occurs on the feeder that impacts the power system quality or operation. The maximum amount of PV that can be placed at each location on the feeder is the locational hosting capacity (LHC). The hosting capacity (HC) of the feeder is the largest amount of PV that can be placed anywhere on the feeder, which is equivalent to the lowest LHC of the feeder.

Throughout the rest of the paper, the PV hosting capacity (HC) and locational hosting capacity (LHC) are analyzed. Each feeder has a single HC value, so there are 216 total HC values. On the other hand, there are many possible interconnection locations on a feeder, so there is a range of LHC values on each feeder. In the 216 feeders, a total of ~60,000 interconnection locations are studied. A histogram of the HC for the 216 feeders analyzed is shown in Fig. 3. The average hosting capacity is 2.05MW, and the median HC is 1.4MW.

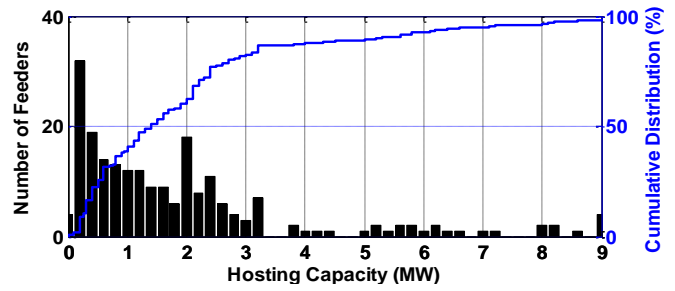


Fig. 3. Pareto plot of hosting capacity for all feeders.

The hosting capacity can also be plotted as a percentage of the feeder's peak load, as seen in Fig. 4. While this matches the more conventional idea of penetration of PV on the feeder, it is becoming a well-established fact that hosting capacity has little relation to feeder peak load [17-19]. In fact, for these 216 feeders, there is an insignificant correlation coefficient of 0.319 between feeder peak load and hosting capacity. If the linear model is forced to have an intercept at zero, there is an R^2 value of 0.014. This demonstrates how uncorrelated and poor of a fit peak load is to hosting capacity. Because peak load is not correlated with hosting capacity, dividing the distribution in Fig. 3 by the almost random numbers of peak load results in a very similar shaped distribution in Fig. 4. In order to keep the results meaningful, the analysis of the paper is done in real units (MW) instead of normalizing to the uncorrelated number of feeder peak load.

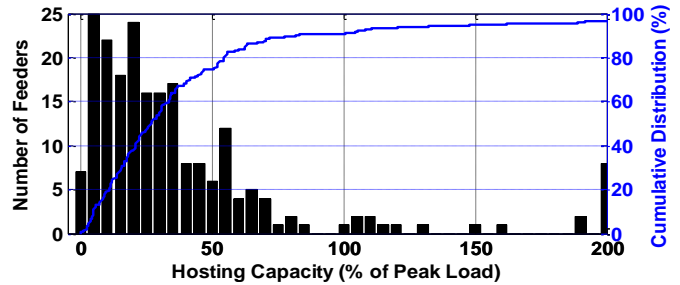


Fig. 4. Pareto plot of hosting capacity in percent of each feeder's peak load.

Since the HC is the minimum LHC on the feeder, the distribution of LHC goes to larger possible PV sizes on the feeder. For example, the HC of the feeder could be the maximum amount of PV that could be placed at the end of the feeder, while the locational hosting capacity of a potential PV interconnection near the substation could be very large without causing issues. Fig. 5 show the histogram of LHC for all 60,000 PV interconnection locations on the 216 feeders. The average locational hosting capacity is 5.1MW, and the median LHC is 3.2MW.

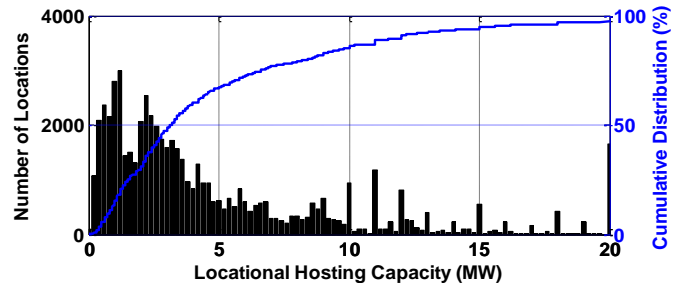


Fig. 5. Pareto plot of locational hosting capacity for all buses.

IV. RESULTS AND ANALYSIS

A. Hosting Capacity Dependence on Feeder Load

PV hosting capacity analysis is often a snapshot static analysis so that the computations can be achieved in a reasonable timeframe. The methodology in [7, 15] only includes the endpoints (most extreme) of lowest and highest load that have occurred on the feeder during daytime hours of 10am to 2pm. In order to study whether the hosting capacity is limited mostly under the minimum or maximum daytime load, Table II shows the time period that drove both the hosting capacity and locational hosting capacity. From these results, it is most important to study the daytime minimum load period, but daytime peak load periods should also not be ignored because issues caused by PV can first appear under higher levels of load. One interesting finding is that LHC is more often correlated with minimum daytime load than the HC.

TABLE II. THE PERCENT OF FEEDER HOSTING CAPACITIES (HC) AND LOCATIONAL HOSTING CAPACITIES (LHC) THAT FIRST VIOLATED UNDER DAYTIME MINIMUM OR PEAK LOAD

	HC	LHC
Daytime Minimum Load	80%	89%
Daytime Peak Load	20%	11%

Fig. 6 and Fig. 7 show histograms of the HC and LHC colored by the load level that issues were first detected. Daytime peak load seems to have more impact on the lower HC and LHC.

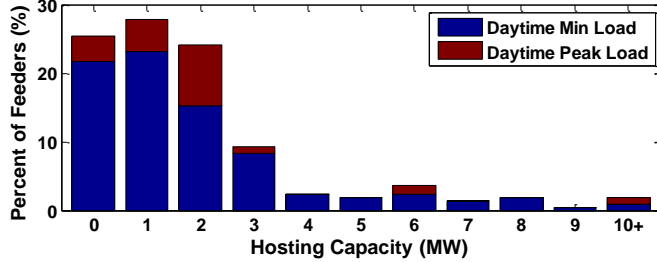


Fig. 6. Stacked histogram of feeder hosting capacity colored by the load level that determined the hosting capacity.

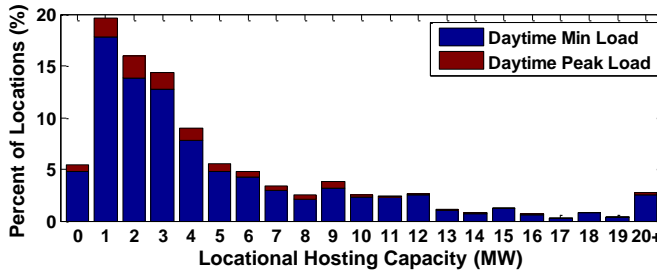


Fig. 7. Stacked histogram of locational hosting capacity colored by the load level that determined the hosting capacity of that location.

B. Hosting Capacity by Violation Type

Similar to the previous section, the hosting capacity and locational hosting capacity are now compared to the reason that more PV could not be installed. The detailed analysis checks for several different types of grid issues that can be

caused by PV, each of which can result in a violation that limits the maximum allowable PV size. Fig. 8 and Fig. 9 show the percentages of HC and LHC that are limited by each type of violation studied. The results here match previous studies [20] that show most of the feeders and locations are limited by over-voltages caused by the PV. The percent of locations with LHC limitations caused by distribution system lines being overloaded is much higher than the percent of HC. This is due to potential PV locations closer to the substation or voltage regulators that may stay within normal voltage ranges but violate the thermal ratings of the conductors. Line overloads caused by PV occur when the reverse current on the line is high, so line violations mostly occur under minimum daytime load conditions. The higher percentage of LHC being limited by thermal violations explains the increased correlation of LHC to minimum daytime load compared to HC as shown in Table II.

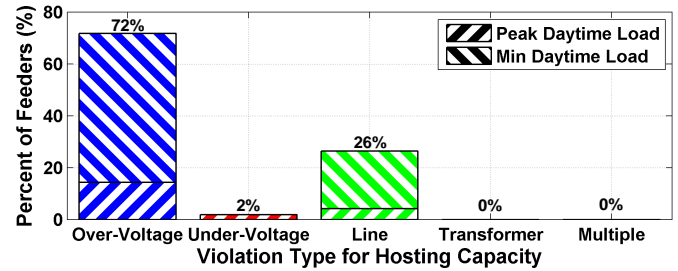


Fig. 8. Percent of feeder hosting capacities limited by each violation type.

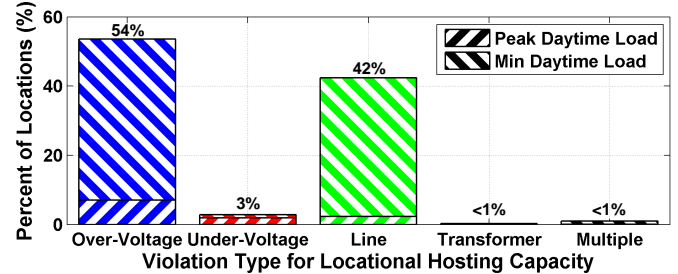


Fig. 9. Percent of locations limited by each violation type.

Fig. 10 and Fig. 11 show the histogram of HC and LHC colored by the type of violation that was first caused by PV. For both HC and LHC, over-voltage issues dominate the low hosting capacities, and line loading issues become more common when large PV systems are studied.

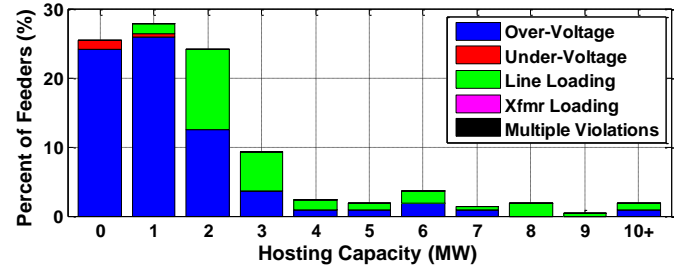


Fig. 10. Stacked histogram of feeder hosting capacity colored by the type of violation that determined the hosting capacity.

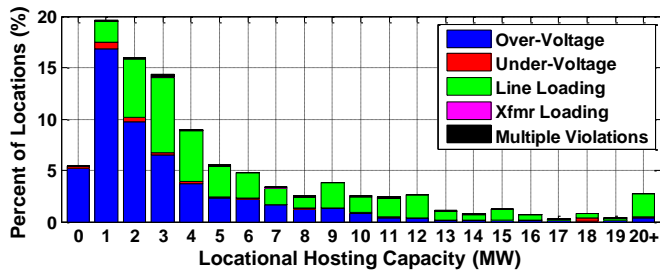


Fig. 11. Stacked histogram of locational hosting capacity colored by the type of violation that determined the hosting capacity of that location.

C. Hosting Capacity by Voltage Level

The grid impacts caused by PV are highly dependent on the voltage level of the feeder. The lower voltage classes result in more current injection for the same PV size, which causes more losses, more voltage change, and more thermal overloads. The results from the 216 feeders have been separated into four voltage classes, as shown in Fig. 12. The CDF of feeder hosting capacities demonstrates how differently each voltage class responds. For example, the 4kV feeders generally have a HC less than 1MW, but none of the 34kV feeders have a HC less than 1MW.

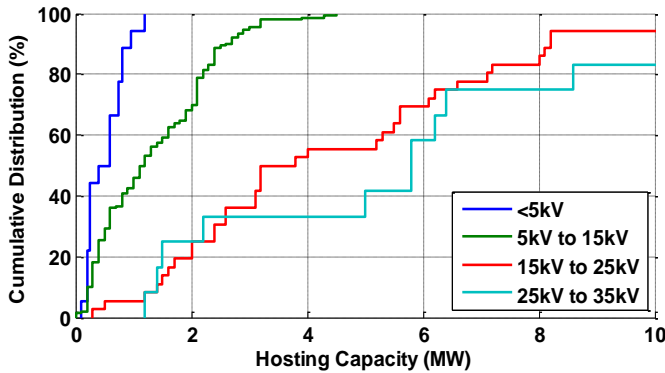


Fig. 12. CDF of feeder hosting capacity separated by voltage class.

The results for LHC grouped by feeder voltage class demonstrate similar results in Fig. 13. In fact, since the HC is the minimum LHC, the initial increase (intersection with the x-axis) is the same in both figures. However, the cumulative distribution function (CDF) of the LHC is significantly higher for the other buses on each feeder.

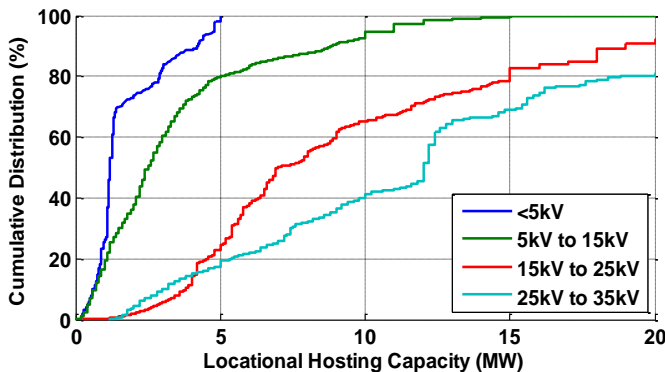


Fig. 13. CDF of locational hosting capacity separated by voltage class.

The distribution of HC and LHC can also be visualized using a box and whisker plots shown in Fig. 14 and Fig. 15. The red line shows the median, and the blue box shows the middle quartiles (from the 25th to 75th percentile). For both the HC and LHC, the median voltage increases with the voltage level of the feeder. For each voltage level, the median LHC is approximate twice the median HC.

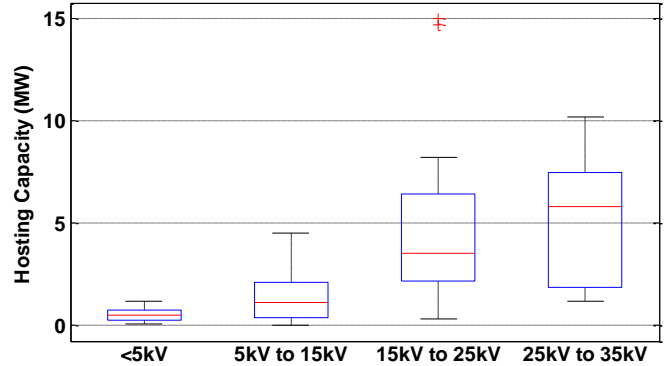


Fig. 14. Box plot of feeder hosting capacity separated by voltage class.

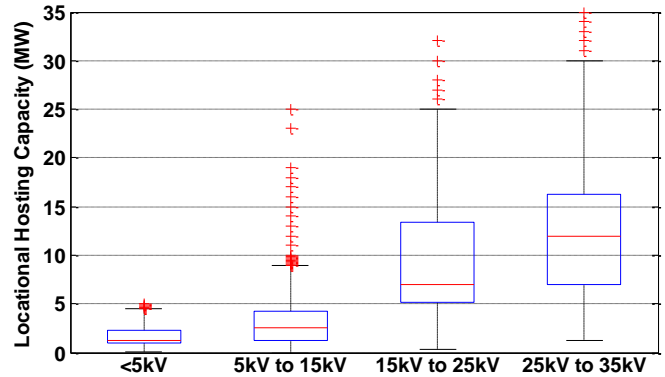


Fig. 15. Box plot of locational hosting capacity separated by voltage class.

D. Correlation between Voltage Level and Violation Type

Using the methodology in [15], the PV interconnection risk is visualized for each interconnection, instead of only the first problem caused on the feeder. For example, if an over-voltage violation was mitigated using a smart grid method like [21] to increase the PV hosting capacity, the question is how much higher of a PV penetration can be placed on the feeder. Due to the differences in voltage classes noted in the previous section, the analysis is separated by voltage class. The two most common voltage classes (12kV and 20kV) are shown in Fig. 16 and Fig. 17 for an aggregate of all locations on all feeders at the voltage class. The black lines in Fig. 16 and Fig. 17 match the corresponding lines for their voltage class in Fig. 13. By separating out the type of violations, new insights can be found, such as that under-voltage issues can arise more than 15% of the time on 12kV feeder with 10MW PV systems even though this violation is not often the first issue. There is also a clear trend on the 12kV feeders where many of the conductors are rated in the 2-4 MW range (100 – 200 amps). On the other hand, the 20kV voltage class feeders have a much wider range of conductor ratings with the green line slowing increasing from 4MW to 12MW in Fig. 17.

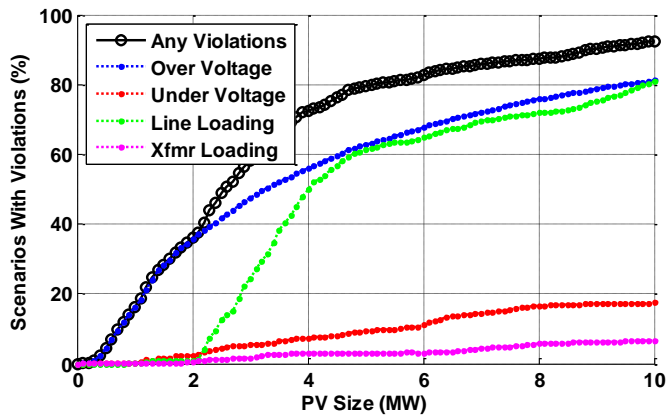


Fig. 16. PV scenarios on all 5kV to 15kV feeders that have violations.

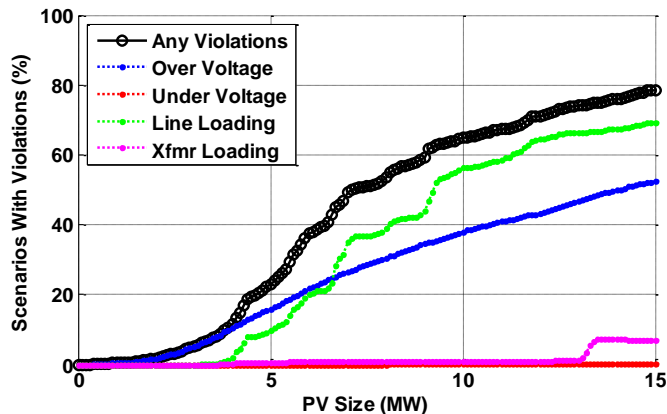


Fig. 17. PV scenarios on all 15kV to 25kV feeders that have violations.

V. CONCLUSIONS

A large database of 216 medium-voltage distributions feeders have been analyzed in detail for their PV hosting capacity. The locational hosting capacities for locations around each feeder are also studied for around 60,000 potential PV interconnection locations. The details of the hosting capacity methodology have been presented in previous work, but in this paper presents novel hosting capacity results and analysis to compare correlations with feeder load, percent of issues caused, and the variation for different feeder voltages. The PV hosting capacity of most feeders is limited by over-voltages caused by PV, but line loading thermal limitations often become the violation that determines the locational hosting capacity. Both HC and LHC are largely limited under low load conditions on the feeder, such as minimum daytime load, but occasionally the first issue caused by PV can occur at peak daytime load. Finally, the HC and LHC are highly dependent on the voltage level of the feeder, and the types of issues caused by PV also change depending on the voltage class.

REFERENCES

- [1] N. Etherden and M. H. J. Bollen, "Increasing the hosting capacity of distribution networks by curtailment of renewable energy resources," in *IEEE Trondheim PowerTech*, 2011.
- [2] A. Hoke, R. Butler, J. Hambrick, and B. Kroposki, "Steady-State Analysis of Maximum Photovoltaic Penetration Levels on Typical Distribution Feeders," *IEEE Transactions on Sustainable Energy*, 2012.
- [3] "Stochastic Analysis to Determine Feeder Hosting Capacity for Distributed Solar PV," EPRI, Technical Report 1026640, 2012.
- [4] M. Kolenc, I. Papič, and B. Blažič, "Assessment of maximum distributed generation penetration levels in low voltage networks using a probabilistic approach," *International Journal of Electrical Power & Energy Systems*, vol. 64, 2015.
- [5] A. Navarro, L. F. Ochoa, and D. Randles, "Monte Carlo-based assessment of PV impacts on real UK low voltage networks," in *IEEE Power and Energy Society General Meeting*, 2013.
- [6] "Distributed Photovoltaic Feeder Analysis: Preliminary Findings from Hosting Capacity Analysis of 18 Distribution Feeders," EPRI, Technical Report 3002001245, 2013.
- [7] K. Coogan, M. J. Reno, and S. Grijalva, "Locational Dependence of PV Hosting Capacity Correlated with Feeder Load," in *IEEE PES Transmission & Distribution Conference & Exposition*, 2014.
- [8] D. Menniti, M. Merlo, N. Scordino, and F. Zanellini, "Distribution network analysis: A comparison between hosting and loading capacities," in *International Symposium on Power Electronics, Electrical Drives, Automation and Motion (SPEEDAM)*, 2012.
- [9] K. P. Schneider, Y. Chen, D. P. Chassin, R. Pratt, D. Engel, and S. Thompson, "Modern Grid Initiative Distribution Taxonomy Final Report," Pacific Northwest National Laboratory 2008.
- [10] J. E. Quiroz and C. P. Cameron, "Technical Analysis of Prospective Photovoltaic Systems in Utah," Sandia National Laboratories SAND2012-1366, 2012.
- [11] EPRI. (2015). *EPRI Test Circuits*. Available: <http://ewh.ieee.org/soc/pes/dsacom/testfeeders/>
- [12] R. J. Broderick, J. E. Quiroz, M. J. Reno, A. Ellis, J. Smith, and R. Dugan, "Time Series Power Flow Analysis for Distribution Connected PV Generation," Sandia National Laboratories SAND2013-0537, 2013.
- [13] J. Peppanen, J. Grimaldo, M. J. Reno, S. Grijalva, and R. Harley, "Increasing Distribution System Model Accuracy with Extensive Deployment of Smart Meters," *IEEE PES General Meeting*, 2014.
- [14] "Alternatives to the 15% Rule: Modeling and Hosting Capacity Analysis of 16 Feeders," EPRI, Technical Report 3002005812, 2015.
- [15] M. J. Reno, K. Coogan, S. Grijalva, R. J. Broderick, and J. E. Quiroz, "PV Interconnection Risk Analysis through Distribution System Impact Signatures and Feeder Zones," in *IEEE PES General Meeting*, 2014.
- [16] M. J. Reno and K. Coogan, "Grid Integrated Distributed PV (GridPV) Version 2," Sandia National Labs SAND2014-20141, 2014.
- [17] M. J. Reno and R. J. Broderick, "Technical Evaluation of the 15% of Peak Load PV Interconnection Screen," in *IEEE Photovoltaic Specialists Conference*, 2015.
- [18] M. Rylander, R. J. Broderick, M. J. Reno, K. Munoz-Ramos, J. E. Quiroz, J. Smith, *et al.*, "Alternatives to the 15% Rule," Sandia National Laboratories SAND2015-10099, 2015.
- [19] M. Coddington, B. Mather, B. Kroposki, K. Lynn, A. Razon, A. Ellis, *et al.*, "Updating Interconnection Screens for PV System Integration," National Renewable Energy Laboratory NREL/TP-5500-54063, 2012.
- [20] A. Navarro-Espinosa and L. F. Ochoa, "Probabilistic Impact Assessment of Low Carbon Technologies in LV Distribution Systems," *IEEE Transactions on Power Systems*, pp. 1-12, 2015.
- [21] J. Seuss, M. J. Reno, R. J. Broderick, and S. Grijalva, "Improving Distribution Network PV Hosting Capacity via Smart Inverter Reactive Power Support," in *IEEE PES General Meeting*, Denver, CO, 2015.

Sandia National Laboratories is a multi-program laboratory managed and operated by Sandia Corporation, a wholly owned subsidiary of Lockheed Martin Corporation, for the U.S. Department of Energy's National Nuclear Security Administration under contract DE-AC04-94AL85000.